



DETAIL "A"
VAULT SLAB TOP AND SIDEWALK ABUTTING

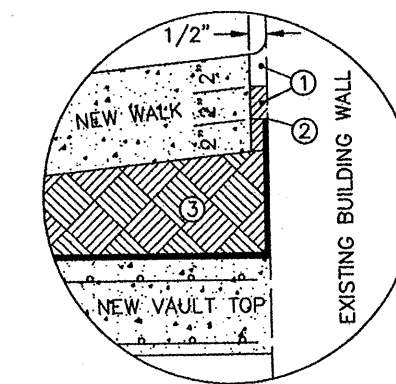


DETAIL "B"
VAULT SLAB TOP AND SIDEWALK SEPARATED

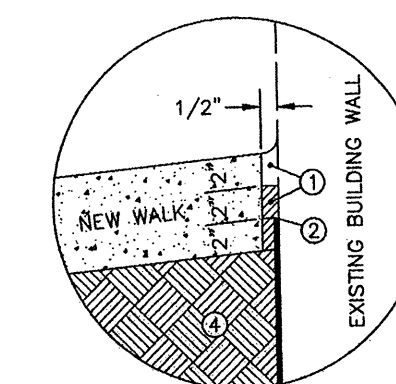

DETAIL "C"
SIDEWALK ONLY

- ① 1/2" x 6" PREMOLDED EXPANSION JOINT MATERIAL. REMOVE TOP 2" AND FILL WITH FLEXIBLE JOINT SEALER, FILLETED AT THE WALL.
- ② EXTEND POLYETHYLENE FILM MINIMUM 2" ABOVE BOTTOM OF SIDEWALK.
- ③ COMPACTED STABILIZED BACKFILL (OR BULK CONCRETE).
- ④ COMPACTED STABILIZED BACKFILL.

PERMIT IS REQUIRED FROM BUILDING DEPARTMENT

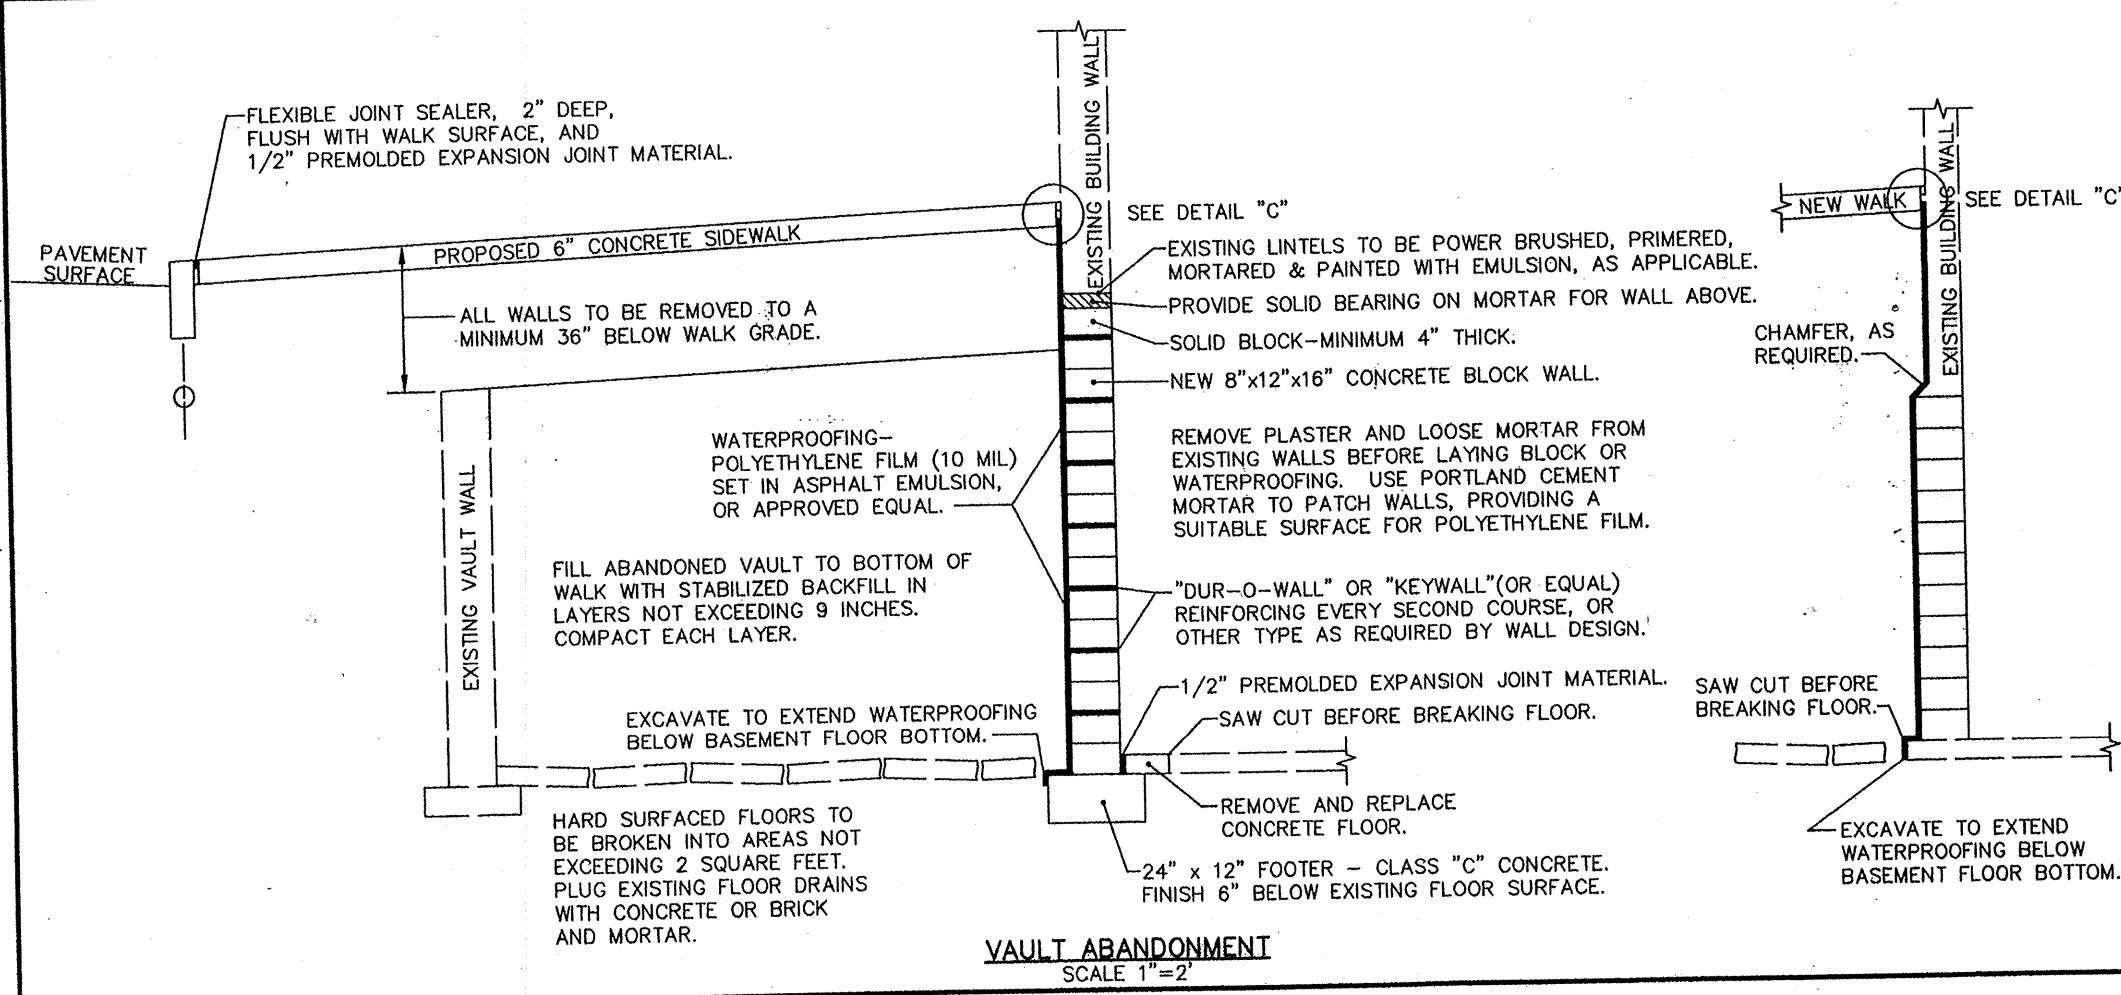

DO NOT SCALE - USE DIMENSIONS ONLY

CITY OF AKRON BUREAU OF ENGINEERING	CONSTRUCTION STANDARD DWG. No. BP-7
<i>David M. ... 5-6-97</i> MANAGER, DESIGN DIVISION <i>Pawan K. Khailan 5/13/97</i> MANAGER, CONSTRUCTION DIVISION <i>C. David ... 5/13/97</i> CITY ENGINEER	SIDEWALK VAULTS RECONSTRUCTION & ABANDONMENT REVISIONS: